

KIT VANNE 3 VOIES
KIT VALVE 3 WAYS
3-VEJS VENTIL SÆT
KIT VALVULA 3 VÍAS
KIT VÁLVULA 3 VIAS

Chaudière Fioul Condensation
Oil Boiler Condensation
Kondenserende oliekedel
Caldera de Condensación de Gasóleo
Caldeira de Condensação a Gasóleo



FOURNITURE KIT / SUPPLY KIT / SAMMENSÆTNING AF SÆT / COMPOSICIÓN DEL KIT / COMPOSIÇÃO DO KIT

FR	
1	Module AVS75.390
2	Sonde départ QAD36
3	Câble nappe
4	Vanne mélangeuse (non fournie)
5	Pompe vanne mélangeuse (non fournie)
6	Câble de connection électrique (non fourni)

ES	
1	Módulo AVS75.390
2	Sonda ida QAD36
3	Cable de conexión
4	Válvula mezcladora (no suministrada)
5	Circulador de válvula mezcladora (no suministrado)
6	Cable de conexión eléctrica (no suministrado)

EN	
1	AVS75.390 room module
2	QAD36 flow sensor
3	Connection cable
4	Mixing valve (not delivered)
5	Mixing valve pump (not delivered)
6	Electrical connection cable (not delivered)

PT	
1	Módulo AVS75.390
2	Sonda ida QAD36
3	Cabo de conexão
4	Válvula misturadora (não fornecida)
5	Bomba de válvula misturadora (não fornecida)
6	Cabo de ligação eléctrica (não fornecida)

DK	
1	Indeklimamodul af typen AVS75.390
2	Fremløbsføler QAD36
3	Kabel
4	Blandeventil (medfølger ikke)
5	Pumpe med blandeventil (medfølger ikke)
6	Tilslutningskabel (medfølger ikke)

POUR LE PARAMETRAGE DE LA REGULATION, SE REPORTER A LA NOTICE DE REGULATION CHAUDIERE.


FOR THE SETTING OF PARAMETER, PLEASE READ THE BOILER MANUAL.

VEDR. INDSTILLING AF PARAMETRE: SE INSTALLATIONSVEJLEDNING

PARA EL AJUSTE DE LOS PARÁMETROS DE REGULACIÓN, VER LAS INSTRUCCIONES DE REGULACIÓN CALDERA.

PARA O AJUSTE DOS PARÂMETROS DE REGULAÇÃO, VER AS INSTRUÇÕES DE REGULAÇÃO DE CALDEIRA DE.

**SCHEMA GENERAL / WIRING DIAGRAM / OVERORDNET DIAGRAM / ESQUEMA GENERAL
PLANO GERAL**

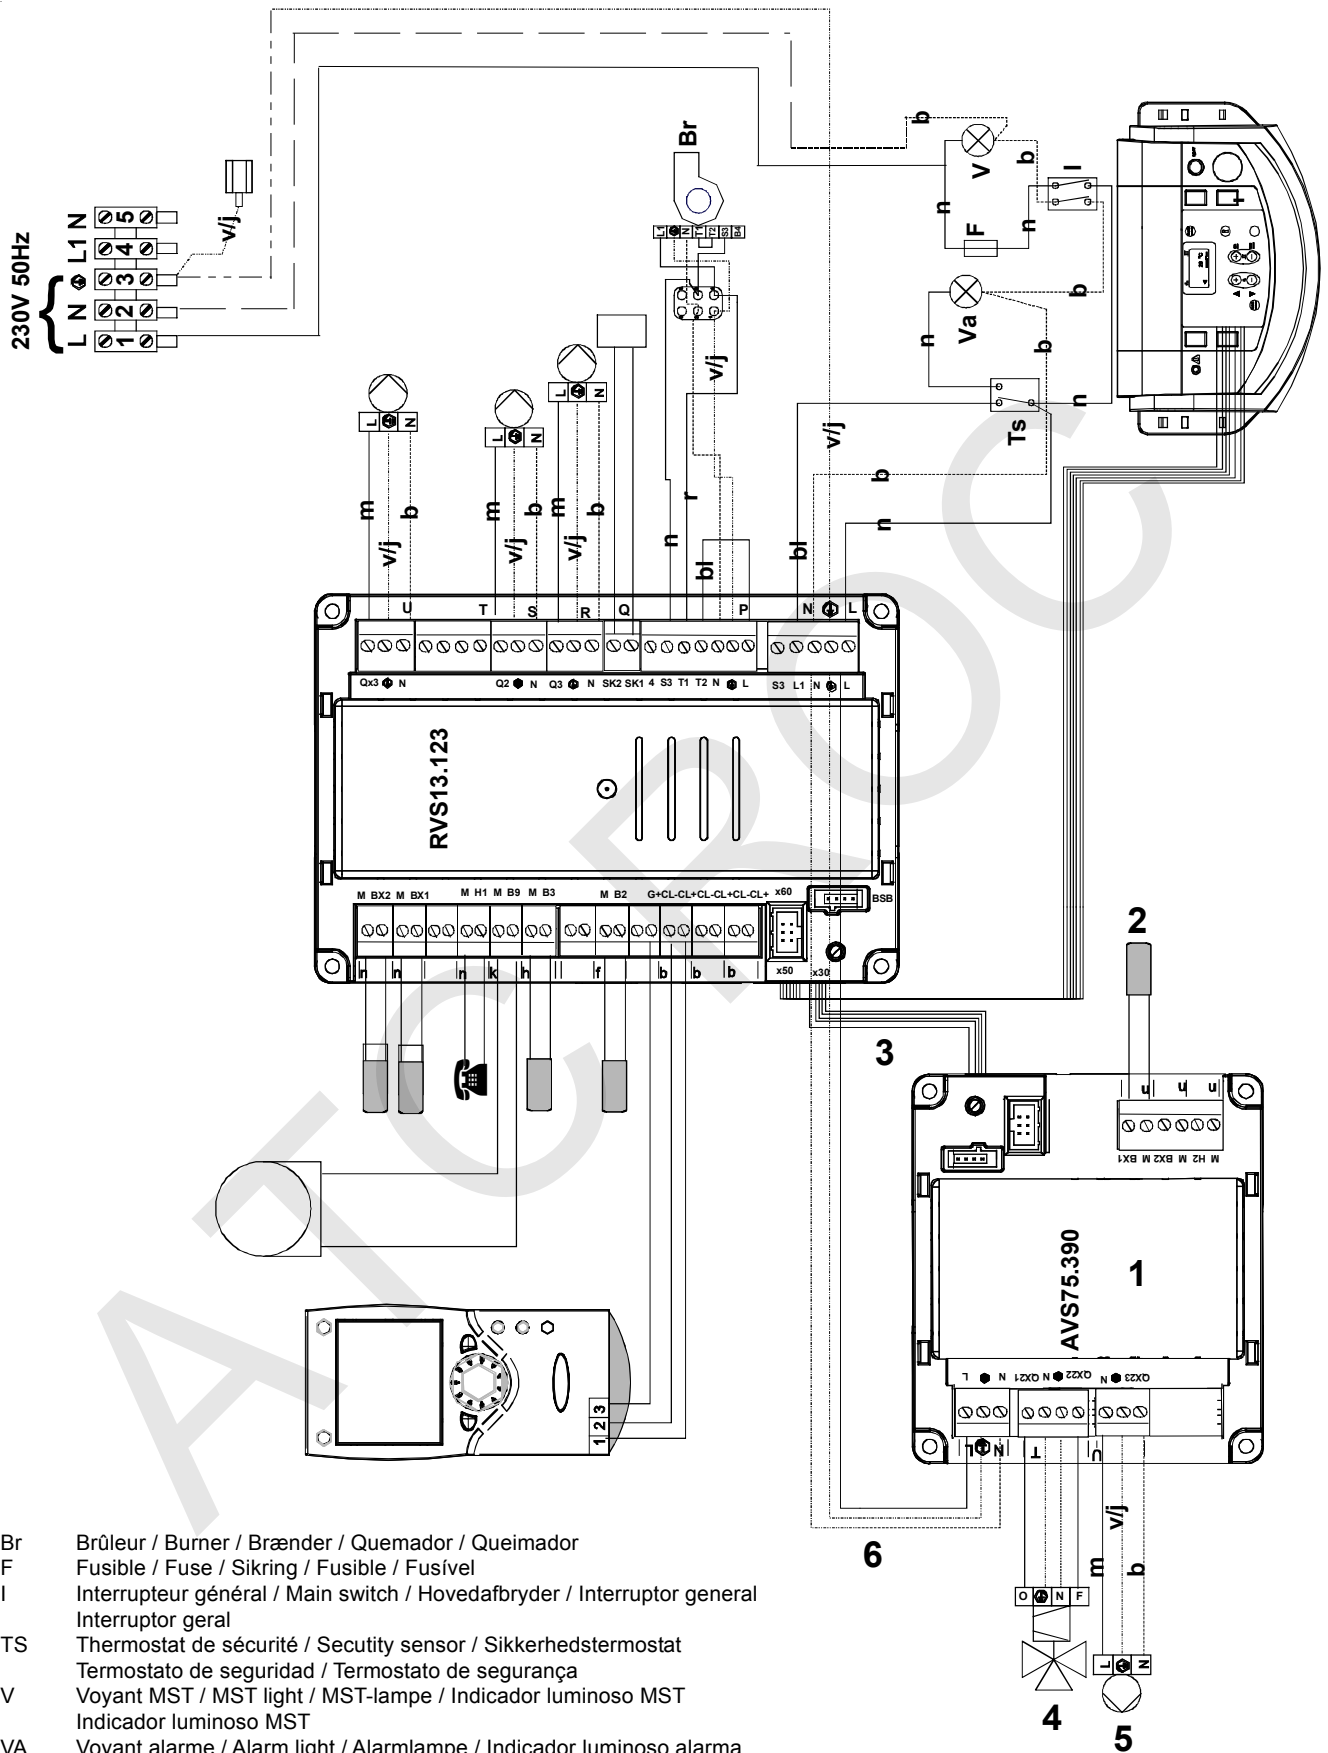

ATCROC

BAXI France

157, Avenue Charles Floquet
93158 Le Blanc-Mesnil - Cedex
Téléphone : + 33 (0)1 45 91 56 00
Télécopie : + 33 (0)1 45 91 59 50

BAXI s.a.
S A au capital de 43 214 640 €
RCS Bobigny B 602 041 675 A.P.E 282 D
A member of **BAXI GROUP LTD**

